
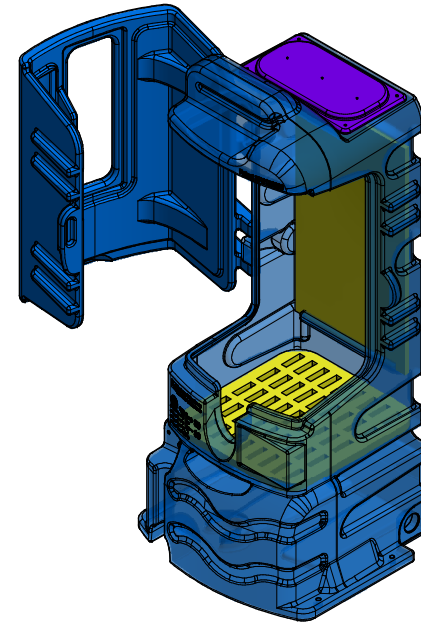
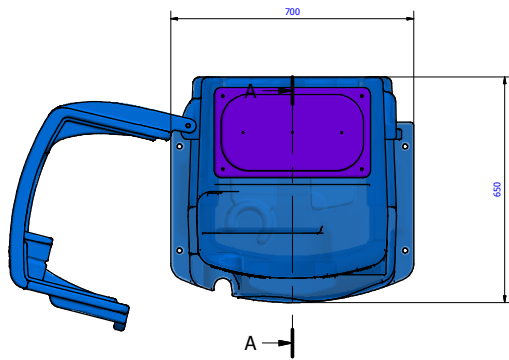
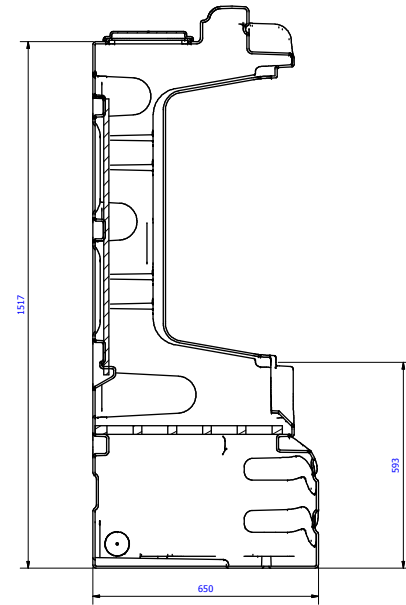


TANK DRY WEIGHT APPROX. 75KGS

A-A ( 0.13 : 1 )

FABRICATION NOTES

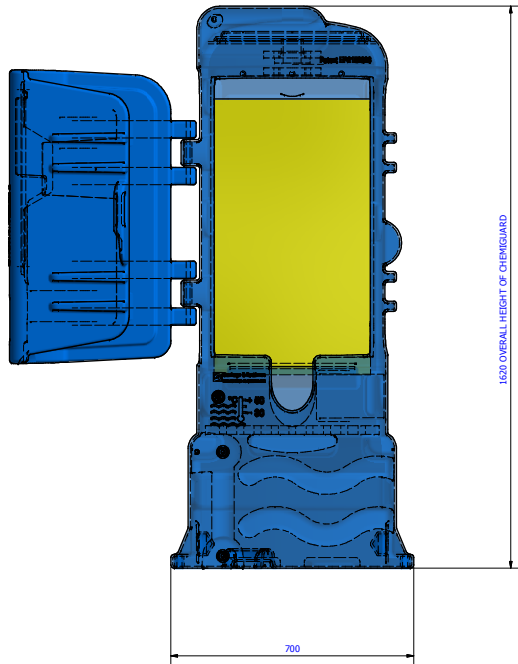

ALWAYS REFER TO PLAN VIEW FOR TRUE ORIENTATIONS

DESIGN DATA		APPROVED WORKING DRAWING	RELATED DRAWINGS			
DESIGN CODE	BSEN 12573		DRAWING NO	TITLE		
DESIGN PRESSURE	ATMOSPHERIC	SIGNED:	NAME: DATE:			
OPERATING PRESSURE	ATMOSPHERIC	THE INFORMATION ON THIS DRAWING IS STRICTLY CONFIDENTIAL TO CHEM-RESIST GROUP LTD AND SHALL NOT BE DISCLOSED TO A THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT ©COPYRIGHT 1998				
DIMENSIONS		INSPECTION AND TESTING				
SPECIFIC GRAVITY		BSEN ISO 9001 QUALITY ASSURANCE IN PROCESS INSPECTION TANK TO BE FILLED WITH WATER FOR 24 HOURS MINIMUM				
DESIGN TEMPERATURE		FABRICATION SPECIFICATION				
OPERATING TEMPERATURE		BASE				
WORKING CAPACITY		LID				
MAXIMUM CAPACITY		BACKING RINGS				
		GASKETS				
		FASTENERS				
		A2 STAINLESS STEEL				
GENERAL TOLERANCE +10mm -10mm		DRAWING NO		TITLE		
DRAWING PRODUCED USING AUTODESK INVENTOR		REV		AMENDMENT		
DO NOT ALTER MANUALLY		1		Preliminary Issue		
DO NOT SCALE - IF IN DOUBT ASK		DATE		BY		
ALL DIMENSIONS IN MILLIMETRES UNLESS STATED		REVISIONS		DATE		
ALWAYS REFER TO PLAN VIEW FOR CORRECT ORIENTATION		JOB No:		CLIENT:		
ALL WELDS TO BE 6x3mm CORD WELDS UNLESS STATED		CE No:		MATERIAL:		
		TITLE		SCALE:		
		PRESSURISED V2 BLOWN DISCHARGE		A1		
		CHEMIGUARD ASSEMBLY		PLOT:		
		DRAWN BY:		DRG No:		
		DATE:		Sheet 1 OF 1		

